
Fundamentals of Asset Management

Step 2. Assess Condition, Failure Modes

A Hands-On Approach


Tom's bad day...



First of 5 core questions, continued

1. What is the condition of my assets?
 - *Why* should we assess condition?
 - *How* do we assess condition?
 - What are the *four major failure modes*?

AM plan 10-step process

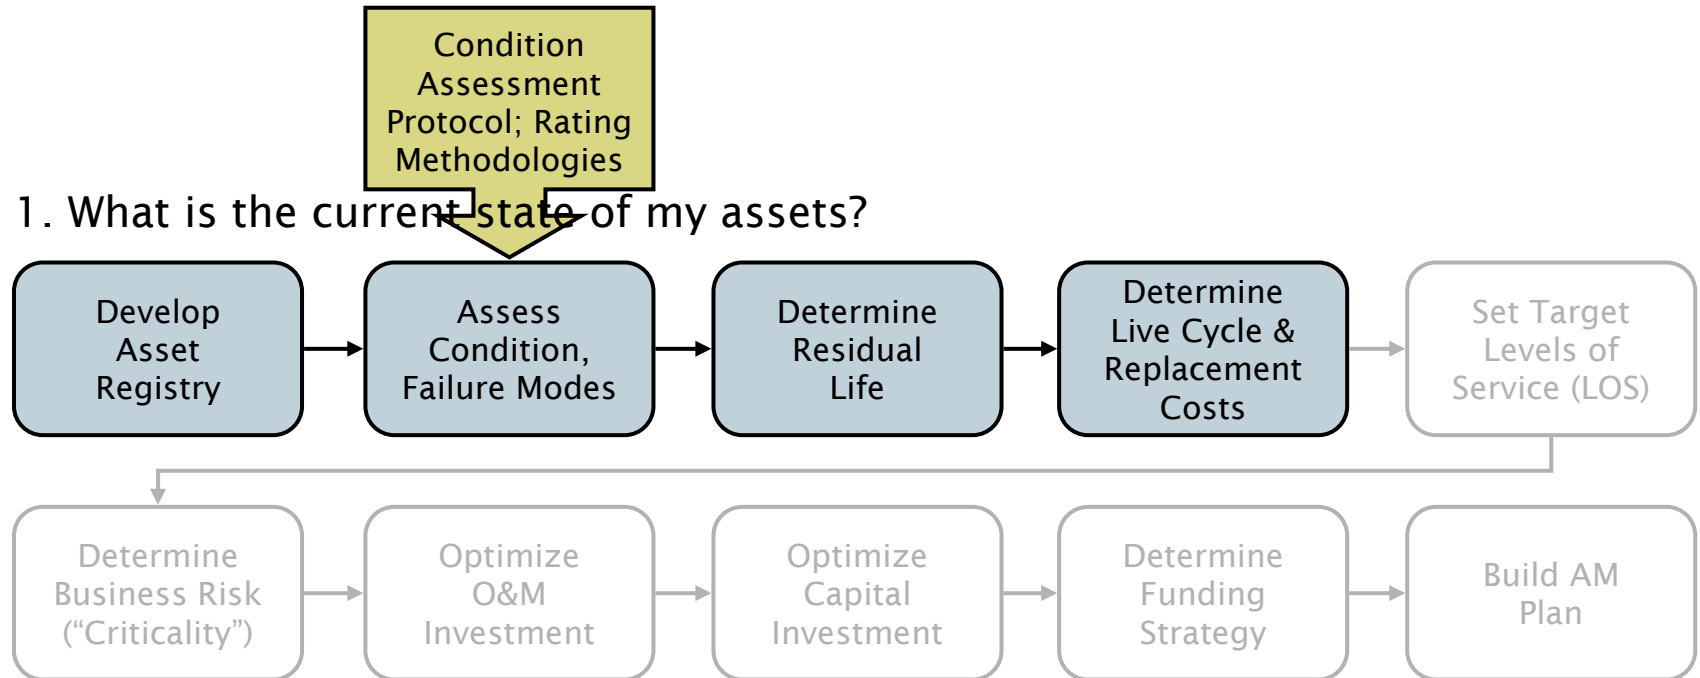

All assets deteriorate and eventually fail



Pipe sediment build-up progressively constricts flow and reduces service



Cleaning and relining restores service and extends useful life, perhaps 50 years

Condition guides timing of *maintenance and renewal investment*

Fundamental principle of condition assessment

Condition assessment is important only to the extent it provides insight into...


- *Nature* of possible failure
 - Root cause
 - Pattern (shape of the deterioration curve)
- *Timing* of possible failure (residual functional life)

Typical condition assessment techniques

- Visual inspection
- Non-destructive testing
- Destructive testing


Methods to assess collection system conditions

- Smoke testing
- Dye testing
- Lamping
- Video inspection (CCTV)
- Sonar
- Ground-penetrating radar

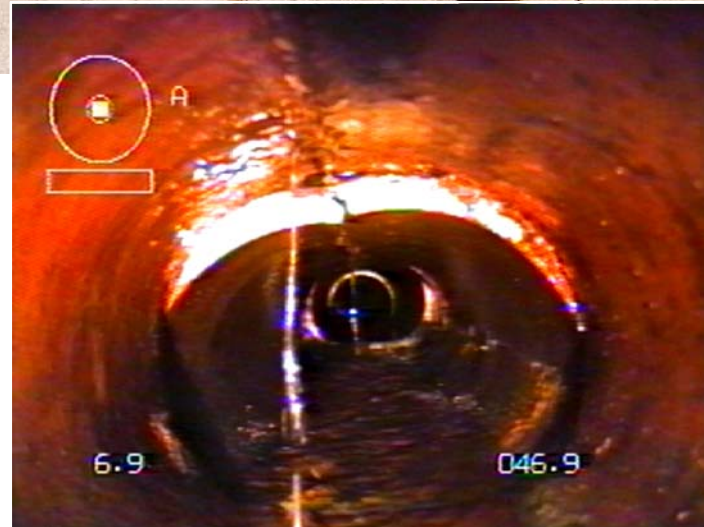

CCTV is closed-circuit television

Evolution of condition technology

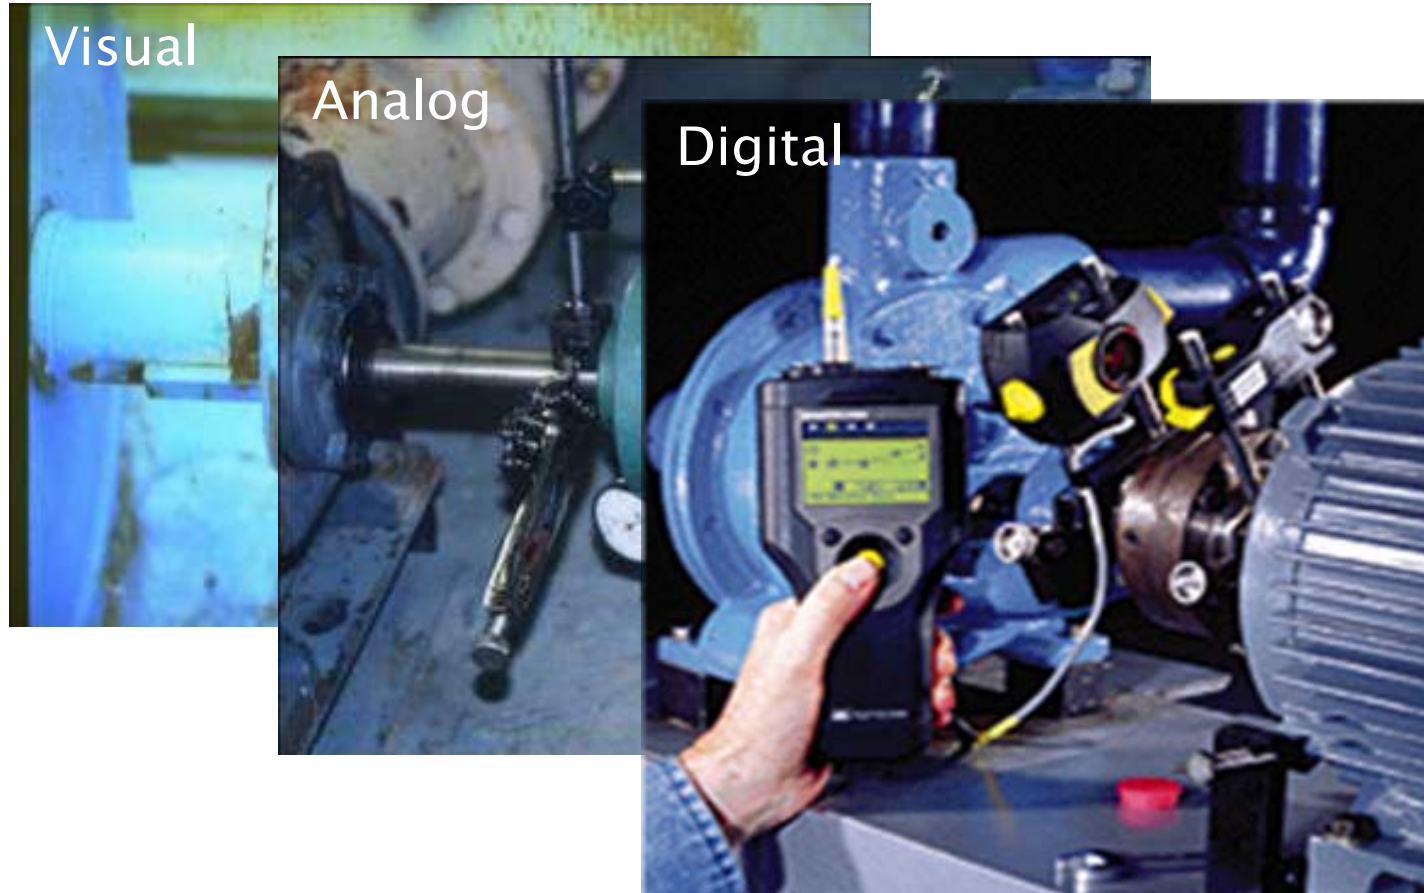

More condition information, faster, at lower cost from technological advances

Early forms of condition definition and ranking

Example One

| | |
|--------------------------|--|
| <i>Condition Class 1</i> | Damage to be repaired immediately |
| <i>Condition Class 2</i> | Damage to be repaired within 1 year |
| <i>Condition Class 3</i> | Damage to be repaired within 3 years |
| <i>Condition Class 4</i> | Damage to be repaired within 7 years |
| <i>Condition Class 5</i> | Damage to be repaired in the course of other construction work |
| <i>Condition Class 6</i> | No damage |

Early forms of condition definition and ranking

Example Two


1. *Urgent repairs*
 - To meet emergency situations
 - To meet legal requirements
2. *Necessary repairs*
 - To eliminate safety hazards and code violations
 - To meet contractual obligations
 - To perform required renovations and repair
3. *Desired repairs*
 - To replace equipment
 - To extend or enhance service
 - To match funds
4. *Ongoing repairs*
 - To continue work in progress
5. *Deferrable repairs*
 - To perform non-essential renovations/improvements
 - To perform projects with questionable need or with timing problems

More evolved form of condition ranking system


- Pipe Rise/Joint Offset
 1. Minor – not critical
 2. Moderate – not critical to flow pattern
 3. Significant – possible infiltration source
 4. Severe – pipe offset impeded/obstructed flow, probable infiltration source
- Pipe Dip
 1. Length 0-10 feet – not critical
 2. Length 11-20 feet – causes minor velocity reductions
 3. Length 21-30 feet – causes solids to settle in pipe
 4. Length >31 feet – can cause significant solids buildup
- Joint Infiltration
 1. Slow drip
 2. Steady drip
 3. Continuous flow – moderate
 4. Continuous flow – severe
- Mineral Buildup (at joint)
 1. Deposit on wall without any noticeable flow restriction – not critical
 2. 0.25 Reduction in pipe diameter, some flow restriction
 3. 0.25-0.5 Reduction in pipe diameter, significant flow restriction
 4. >0.5 Reduction in pipe diameter, camera unable pass – severe flow Reduction
- Laterals with Roots (house lateral)
 1. Some root penetration – no blockage
 2. More established root presence – minimal blockage
 3. 0.5 of lateral is blocked – possible infiltration and flow restriction
 4. Near total blockage – probable infiltration and flow restriction
- Joints with Roots
 1. Some root penetration – no blockage
 2. More established root presence – minimal blockage
 3. 0.5 of pipe blocked – possible infiltration and flow restriction
 4. Near total blockage – probable infiltration and flow restriction
- Pipe Break
 1. Minor Break – no structural impairment
 2. Break with separation – structural impairment not imminent
 3. Break with separation/partial collapse imminent structural failure
 4. Severe breakage requiring immediate attention to maintain flow
- Debris Blocking Pipe
 1. Minor debris – minimal flow restriction
 2. Moderate debris – minor flow restriction
 3. Significant debris – moderate flow restriction
 4. Severe debris – near total flow restriction
- Pipe Cracks
 1. Hairline no structural impairment
 2. Crack with separation structural impairment not imminent
 3. Crack with separation/partial collapse imminent structural failure
 4. Severe crack requiring immediate attention to maintain flow
- Lateral protrusion
 1. <1" minimal flow restriction
 2. >1" moderate but not critical to flow pattern
 3. 0.5-0.75 full pipe blocked – severe flow restriction
 4. 0.75 full pipe blocked – severe flow restriction


Emerging national standards for pipes

Pipe Assessment Certification Program (PACP)



Hole (H)





| Distance (ft) | Video Ref | Code | | Continuous defect | Value | | | Joint | Circumferential location | |
|---------------|-----------|--------------|---------------------|-------------------|-------|--------|-----|-------|--------------------------|----|
| | | Group Design | Modifier / severity | | S/N | Inches | % | | At / from | To |
| | | | | | L | 1st | 2nd | | | |
| 109.4 | | H | | | | | | | 07 | 12 |
| 112.0 | | FL | | | | | | | 12 | 14 |
| 112.1 | | FL | | | | | | | 12 | |
| 112.1 | | FL | | | | | | | 08 | |

Copyright 2001, NASSCO

From National Assoc. of Sewer Service Companies (NASSCO) & Water Research Center (WRC), *Manual of Defect Classification*

Emerging national standards for pipes

*Structural defect scores - Pipe sewers

| Defect | MSCC Code | Description | Score |
|----------------------------------|-----------|---------------------------------|-------|
| Longitudinally displaced joint / | OJM | Medium < 1" pipe thickness | 1 |
| Open joint | OJL | Large > * pipe thickness | 2 |
| | | If soil visible grade as a hole | 165 |
| Radially displaced joint | JDM | Medium < 1" pipe thickness | 1 |
| | JDL | Large > 1" pipe thickness | 2 |
| | | > 10% diameter & soil visible | 80 |
| Cracked | CC | Circumferential | 10 |
| | CL | Longitudinal* | 10 |
| | | Complex* | 40 |
| | | Helical* | 40 |
| | CM | | |
| Fractured | FC | Circumferential | 40 |
| | FL | Longitudinal* | 40 |
| | | Complex* | 80 |
| | | Helical* | 80 |
| | FM | | |
| Broken | B | | 80 |
| Hole | H | Radial extent <¼ | 80 |
| | | Radial extent ¼+ | 165 |
| Collapsed | X | | 165 |

*Abstract from Sewerage Rehabilitation Manual (Fourth Edition)

From National Assoc. of Sewer Service Companies (NASSCO) & Water Research Center (WRC), *Manual of Defect Classification*

Condition assessment protocol (CAP)

Which assets? What information? How used?

CAP 1 Simple scoring system, e.g., 1-5, or 1-10

CAP 2 Matrix scoring system with multiple distress factors and weightings to derive a score

CAP 3 Use of sophisticated techniques to determine the *residual life to intervention* or end of physical life

Characteristics of a good CAP


- Focused on *remaining useful life*, rather than just condition score
- Carefully defined, with good written protocol
- Built around *business risk assessment* (of critical assets)
- Consistently applied (across time, across inspectors)
- Cost effective, using smart *data collection techniques*

Example CAP 1

| <i>Score</i> | <i>Description</i> | <i>Maintenance Level</i> | <i>Percent Replacement</i> |
|--------------|------------------------------|--------------------------|----------------------------|
| 0 | New | Normal | 0 |
| 1 | Perfect/excellent condition | Normal | 0 |
| 2 | Minor defects only | Minor | 5 |
| 3 | Backlog maintenance required | Significant | 10-20 |
| 4 | Major renewal required | Renew | 20-40 |
| 5 | Asset nearly unserviceable | Replace | >50 |

Example of expanded CAP 1.5

Refining CAP scale to fit relative distress of assets

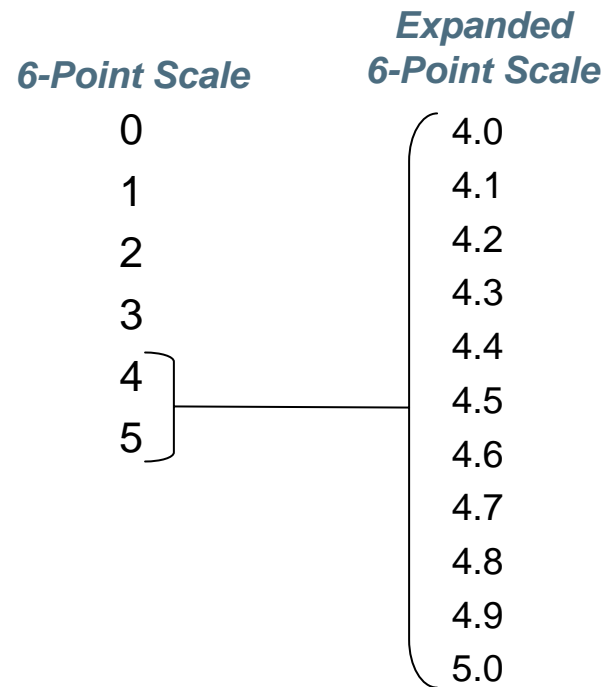

CAP is condition assessment protocol

Example CAP 2

| <i>Distress Mode</i> | <i>Rating (1-5)</i> | <i>Weighting (1-3)</i> | <i>Score</i> |
|----------------------|-------------------------|----------------------------------|--------------|
| Corrosion | 3 | 3 | 9 |
| Vibration | 1 | 1 | 1 |
| Leakage | 2 | 1 | 2 |
| Heat | 4 | 2 | 8 |
| Performance | 2 | 3 | 6 |
| Noise | 1 | 1 | 1 |
| | | <i>Condition Rating</i> | 27 |
| | | <i>Normalized Rating (27/90)</i> | 30 |

Example CAP 3

© Copyright GHD LLC 2005

CITY OF PHOENIX - 24th STREET WATER TREATMENT PLANT

ASSET CONDITION RELIABILITY ASSESSMENT RATING TABLES

Conventional Pumps

Inclusion: Dry well & line shaft pumps Dosing Pumps

| Aspect | Distress Mode | Rating 1 | Rating 2 | Rating 3 | Rating 4 | Rating 5 | Rating 6 |
|-------------------------------|-------------------|-----------------|---------------------------------|-------------------------------------|---|---|---|
| CONDITION ASSESSMENT | | | | | | | |
| C | Use | Motor Hours Run | < 10,000 | > 10,000 | > 50,000 | > 100,000 | > 200,000 |
| D | Symptoms | Vibration | No unusual vibration detectable | Minor vibration detected | Moderate vibration | Considerable vibration (vibratwatch shakes) | Major vibration |
| E | | Temperature | No unusual temperature detected | Minimal heat from casing using hand | Heat detected by hand | Heat detected by hand is uncomfortable | Heat too high to assess by hand |
| F | | Noise | No unusual noises detected. | Slight whine/rattle detected. | Moderate whine/rattle detected, easily heard over pump noise. | Loud whine/rattle. | Disturbingly loud operation/vibrations. |
| RELIABILITY ASSESSMENT | | | | | | | |
| A | Unplanned Outages | Avg No./Year | 0 / Year | < 2 / Year | < 5 / Year | < 10 / Year | > 10 / Year |
| B | Efficiency | Flow Output | Flow within 5% of duty point. | Flow within 10% of duty point. | Flow within 20% of duty point. | Flow within 40% of duty point. | Flow > 40% of duty point. |

Makes use of vibration, sonic, thermal, electrical, oil residue, electromagnetic, and performance signatures—or information


Seven smart ideas for condition data collection

1. *Business risk-driven*, with focus first on high risk, high consequence assets
2. *Problem assets-profiled*, noting that 20% of assets cause 80% of problems
3. *Sampling approach*
4. *Stepped approach*, applying more sophisticated assessment techniques to higher-cost, higher business risk-assets
5. *Failure mode-guided*, do I need condition data?
6. *Root cause-driven*, (Bayesian probability, SCRAPS)
7. *Valued judgment/Delphi approach*, as supplement to minimal data

BRE is business risk exposure; SCRAPS is Sewer Cataloging, Retrieval, and Prioritization System


Idea 1, business risk-driven

What is probability of failure? What is consequence of failure?

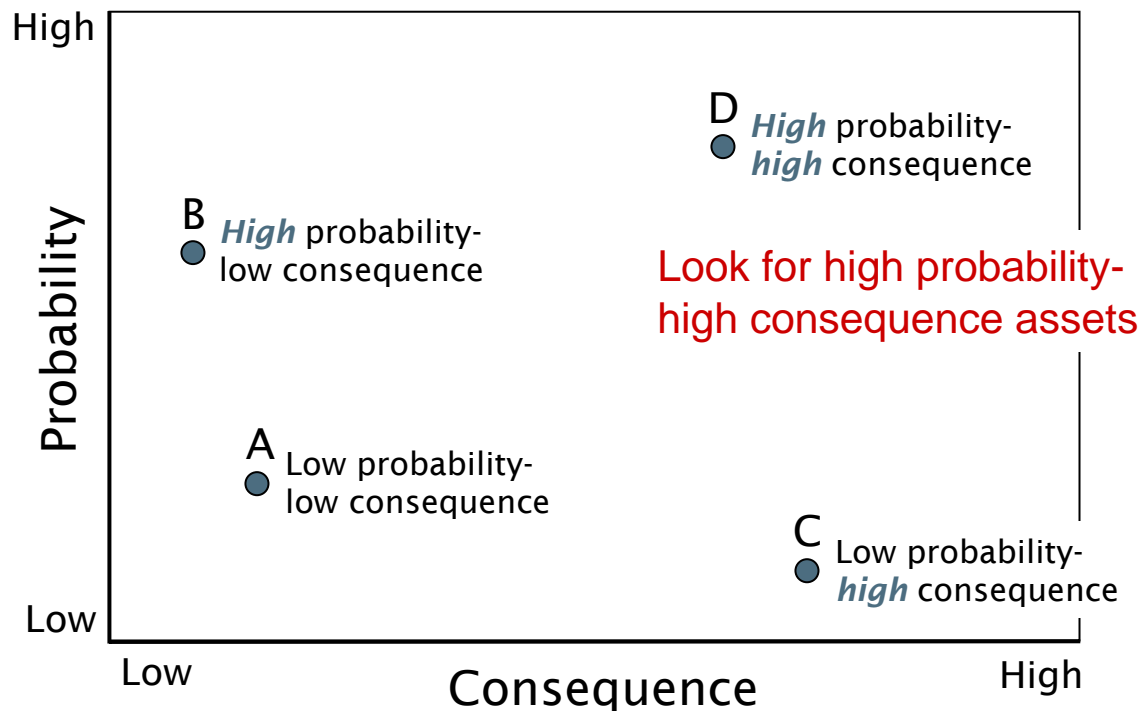

Idea 2, problem assets-profiled

Do we know which are our problem assets?

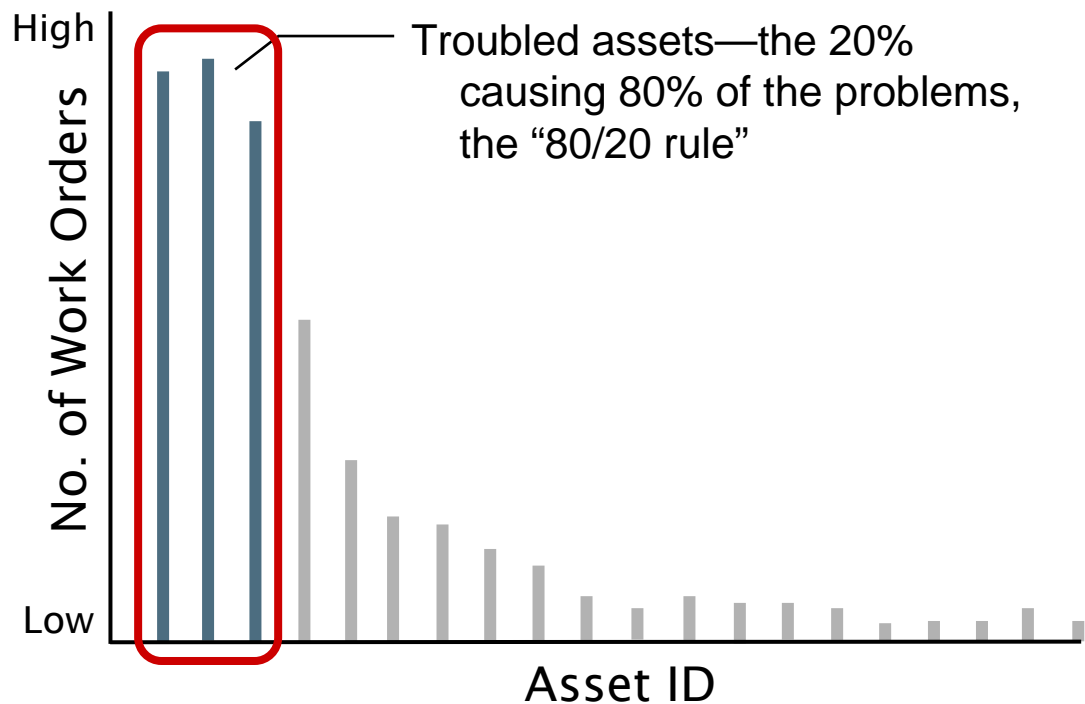


Idea 3, sampling approach

Statistically-sound, validated sampling can render high level of decision confidence at relatively low cost...

- Using *larger* sample size for *more critical* assets and *smaller* size for *less critical*
- Building sample collection around *root causes* of failure—understanding your *failure modes*

Idea 4, stepped approach

Levels of sophistication in condition assessment

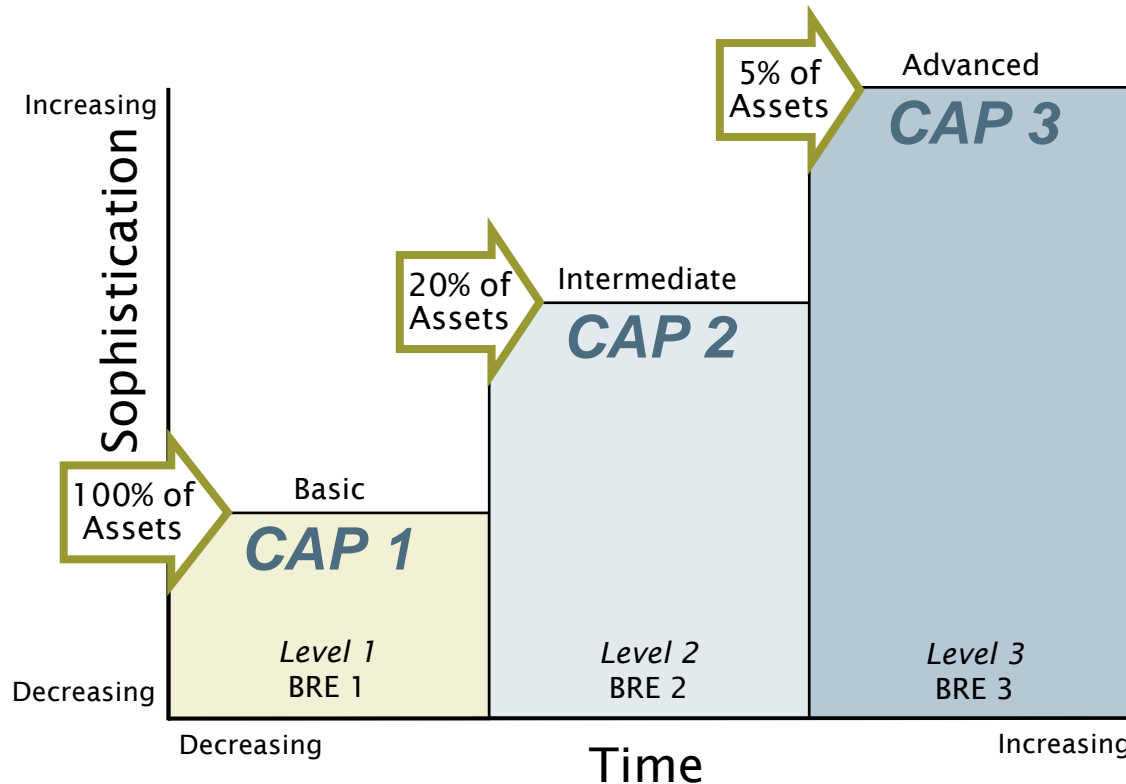

BRE is business risk exposure, CoF is consequence of failure, PoF is probability of failure, MTBF is mean time between failures

Idea 5, failure mode-guided


| <i>Failure Mode</i> | <i>Definition</i> | <i>Tactical Aspects</i> | <i>Management Strategy</i> |
|---------------------|---|---|----------------------------|
| Capacity | Volume of demand exceeds design capacity | Growth, system expansion | (Re)design |
| LOS | Functional requirements exceed design capability | Codes & permits: NPDES, CSOs, OSHA, noise, odor, life safety; service, etc. | (Re)design |
| Mortality | Consumption of asset reduces performance below acceptable level | Physical deterioration due to age, usage (including operator error), acts of nature | O&M optimization, renewal |
| Efficiency | Operations costs exceed that of feasible alternatives | Pay-back period | Replace |

NPDES is National Pollutant Discharge Elimination System, CSOs are combined sewer overflows, and OSHA is Occupational Safety and Health Administration

Condition assessment and the decay curve


Condition assessment assists in recognizing...

- *Nature* and *shape* of the failure or decay (or deterioration) curve
- *Where* on the curve is asset's current condition
- Asset's *remaining useful life*, an estimate

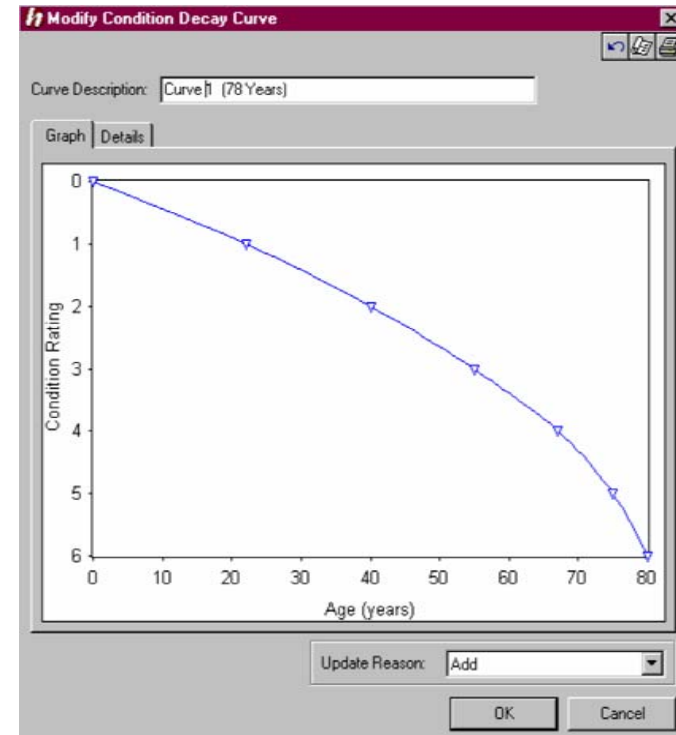


Developing a decay curve

- *Longitudinal* study—uses data collected *over the life* of a *single* asset (or set of assets)
- *Latitudinal* study—uses data collected from *multiple* assets of the same type but of different ages

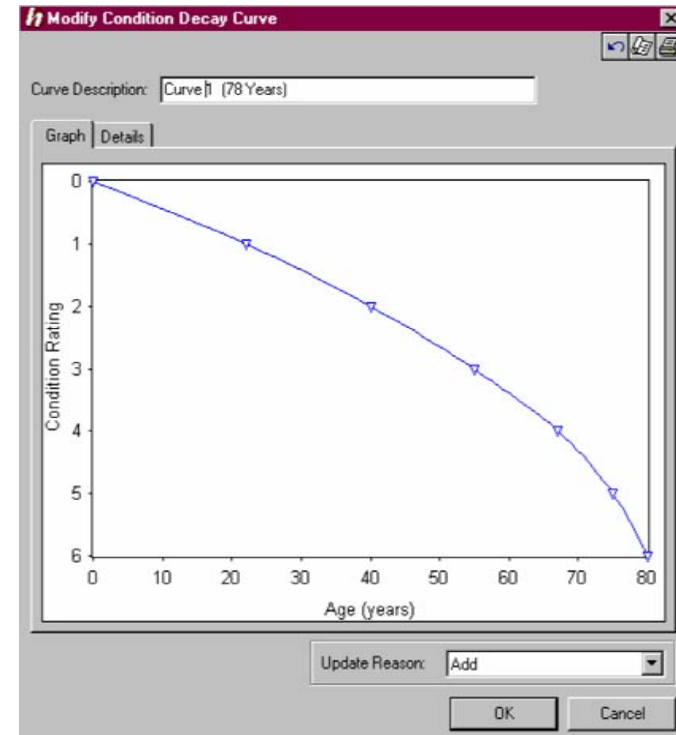

Tying condition score to asset failure

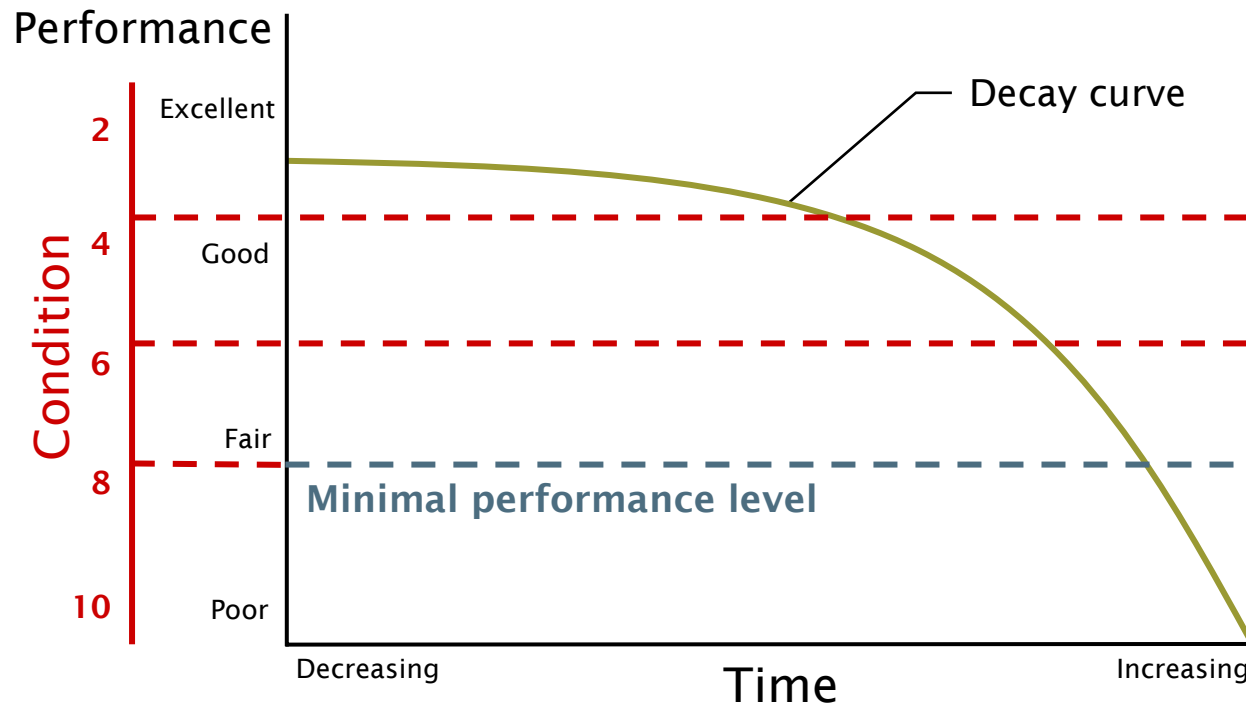

Idea 6, root cause-driven (Bayesian)

- “*Valued judgment*” is used to assign *failure variables and propositions* (sequence of causes of failure)
- “*Valued judgment*” is used to assign *conditional probabilities* (likelihood of occurrence)
- “*Causal path*” networks are developed relating “*root cause*” to functional failure
- *Probabilities* are assigned to each of the path elements

What is SCRAPS?

Sewer Cataloging, Retrieval, and Prioritization System (SCRAPS)




Courtesy of WERF and Brown & Caldwell

Example of Bayesian probability

- *Proposition:* Sewer joint failures are common when the sewer is in marshy soil without support
- Or, equivalently, in Bayesian terms
 - If probability of marshy soil is *high*
 - And probability of sufficient support is *low*
 - Then *probability of joint failure is high*

SCRAPS Bayesian logic structure

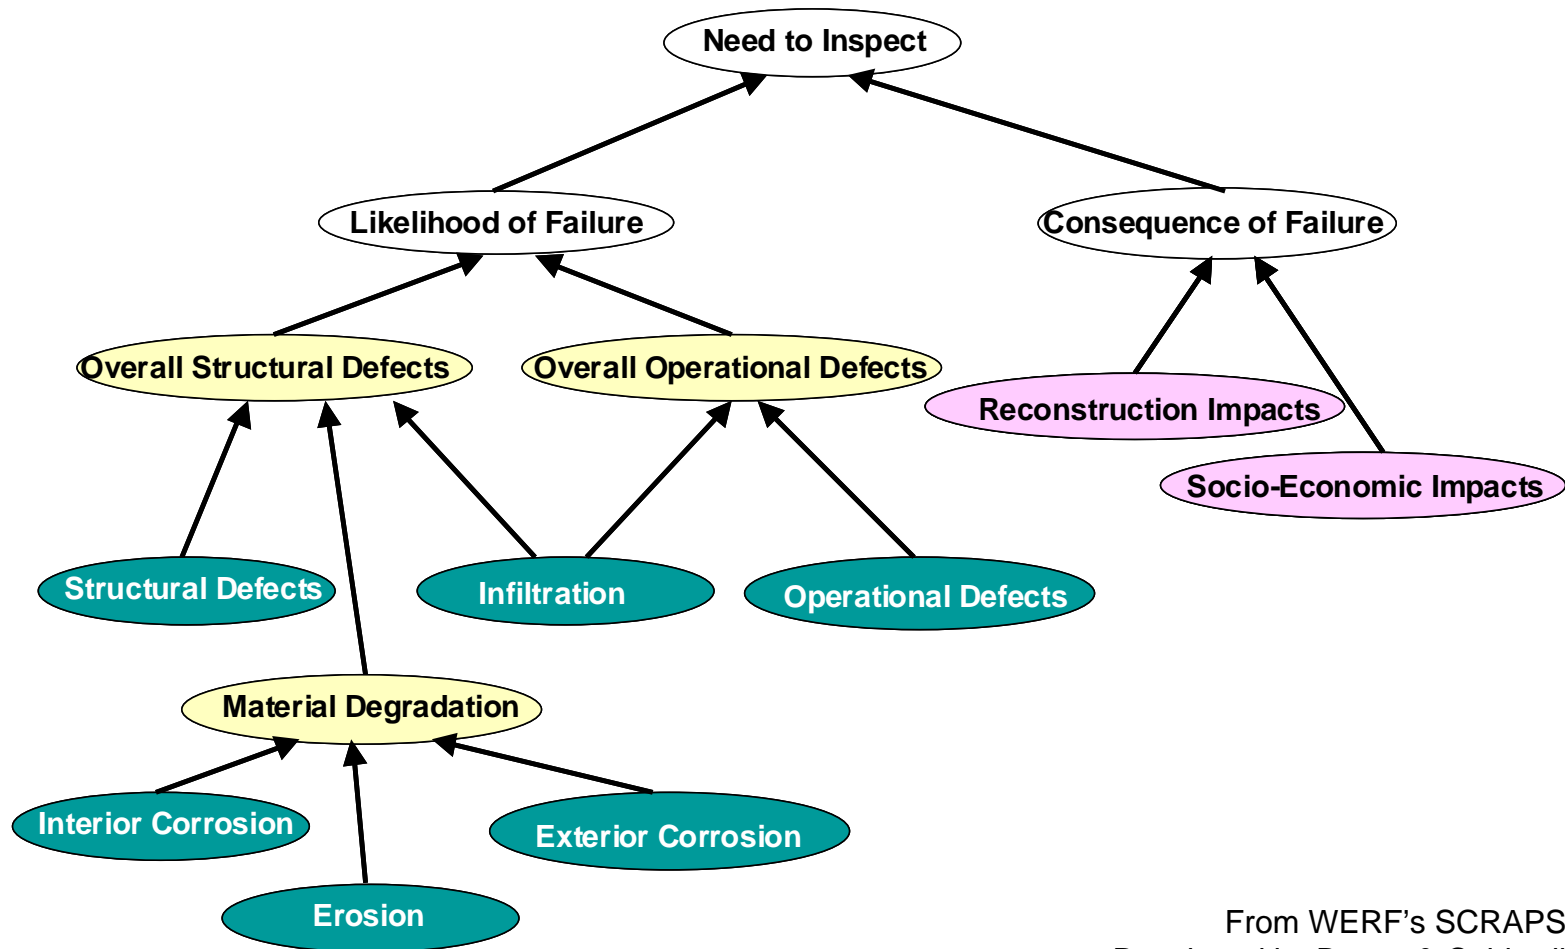


From WERF's SCRAPS
Developed by Brown & Caldwell

Default data manager

The screenshot shows the 'Default Pipe Data Manager' window. At the top, it says 'Default Table Set up'. Below that, there's a title 'Default Pipe Data Manager'. A text box explains: 'You can specify default information that can be applied to new pipes. Specify default information for each of the Basins. Select a Basin to view/edit default information.' Below this is a 'Choose Basin' dropdown menu with 'BLUELAKE' selected. To the right are 'Upstream Facility*' and 'Downstream Facility*' dropdowns with 'Manhole 1' and 'Manhole 2' respectively. Below these are three tabs: '1. General and Historical Pipe Information', '2. Previous Inspection or Improvements', and '3. Pipe Environment Characteristics'. The first tab is active and contains several sub-sections: '1a. Required Information' (Year Installed: 1950, Material: Concrete, Diameter: 12, Invert Depth: 10, Slope: 0.001), '1b. Line Structure' (Line length: 100, Tubulence inducing structure?: None, Number of Lateral Connections per 100 feet?: < 5 per 100', Interior Lining: No, Structural Support: Buried, Frost Protection: No, Designed for pressure flow?: Yes, Interior Lining: No), '1c. Wastewater Volume and Type' (Hydraulic Demand: < 70%, Sanitary or Combined?: Sanitary, Redundancy: Parallel System Exists or Flow Swap), '1d. Surchage' (Surchage frequency: < 1 time per 5 years, Surchage head: < 10', Surchage modeled?: Not Modeled), '1e. Overflows and Releases' (Has an overflow or release been observed? If so, what was the frequency?, Overflow type?, A wet weather or dry weather event?), '1f. Calculated Variables' (Cover Depth, Velocity), and '1g. Construction History' (Poor Joint Construction, Poor Installation Practices?, Poor Materials?). A 'Close' button is at the bottom right.

Courtesy of WERF and Brown & Caldwell

View of pipe information from SCRAPS

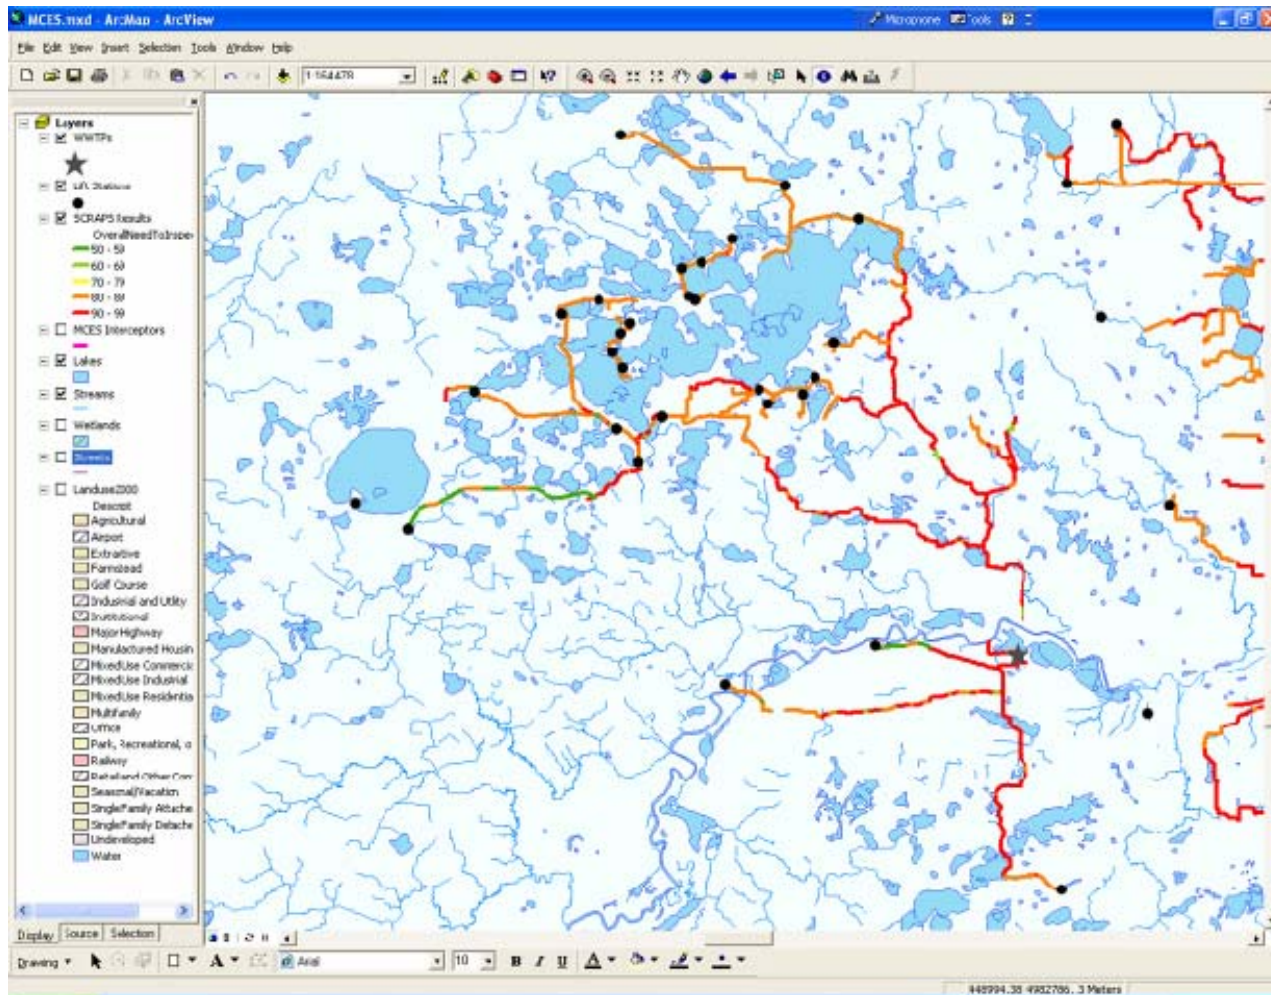

Courtesy of WERF and Brown & Caldwell

Idea 7, valued judgment/Delphi approach supplements minimal data



“Valued judgment” is used to assign condition scores

- Assemble team of most-knowlegeable personnel
- Poll each member for opinion on condition score and why
- Augment with work order data and failure patterns
- Use photos and process schematics
- Facilitate group consensus through discussion

Important note on condition assessment

- Condition assessment is not an end in itself, but is a *means* to an end
- The *end* is to determine *remaining useful life*
- *Good-Fair-Poor*-type ratings have little utility *unless* they lead to an effective estimate of remaining useful life

The remaining useful life of an asset is *what we have left to try to manage*

Key points from this session

What condition is it in?

Key Points:

- Condition assessment rating scales must project remaining useful life to be useful for decision-making
- To be most cost-effective, condition assessment must be guided by the same core concepts that guides all AAM – “failure modes” and the likelihood and consequences of failure

Associated Techniques:

- Condition assessment technology
- Condition rating protocol

Tom's spreadsheet

Microsoft Excel - EPA Seminar Master.xls

File Edit View Insert Format Tools Data Window Help Adobe PDF

Arial 10 B I U

U13 =

| Asset Register and Hierarchy | | | | | What is the State of My Assets? | | | Required LOS? | | Which Are Most "Critical"? | | |
|------------------------------|---------------------|---------------|--------------------------|------------------|---------------------------------|------------|--------------|-------------------|-------------------------------|----------------------------|------------------------|--|
| Installed Date | Asset Class | Original Cost | Estimated Effective Life | Condition Rating | Annual Dep | Accum Dep | Current LOS? | Minimum Condition | Backup Reduction (Redundancy) | Probability of Failure | Consequence of Failure | |
| Year | | \$ | Years | 1 to 10 | \$ | \$ | | | % | Rating | 1 to 10 | |
| Act or Est | Tab A | Act or Est | Calculated | Tab A | Calculated | Calculated | | Tab A | Tab D | Calculated | Tab C | |
| 10 | Sanitation System | | | | | | | | | | | |
| 11 | Disposal System | | | | | | | | | | | |
| 12 | Treatment Plants | | | | | | | | | | | |
| 13 | Collection Systems | | | | | | | | | | | |
| 14 | Sewer Mains | | | | | | | | | | | |
| 15 | Pump Station | | | | | | | | | | | |
| 16 | Incoming Sewer | | | | | | | | | | | |
| 17 | Pipes | 1963 | 3 | \$ 1,725 | 100 | 6 | \$ 17 | \$ 742 | | | | |
| 18 | Manhole | 1963 | 3 | \$ 340 | 100 | 5 | \$ 3 | \$ 146 | | | | |
| 19 | Influent Gate Valve | 1986 | 5 | \$ 442 | 30 | 8 | \$ 15 | \$ 235 | | | | |
| 20 | Incoming Power | | | | | | | | | | | |
| 21 | Pole & Transformer | 2006 | 4 | \$ - | 40 | 1 | \$ - | \$ - | | | | |
| 22 | Connection | 2006 | 7 | \$ - | 35 | 1 | \$ - | \$ - | | | | |
| 23 | Control system | | | | | | | | | | | |
| 24 | Incoming Telephone | 1985 | 8 | \$ 85 | 25 | 7 | \$ 3 | \$ 71 | | | | |
| 25 | PLC | 1983 | 8 | \$ 8,600 | 25 | 8 | \$ 344 | \$ 7,912 | | | | |
| 26 | Manual controls | 1978 | 8 | \$ 425 | 25 | 7 | \$ 17 | \$ 476 | | | | |
| 27 | Land & Improvements | | | | | | | | | | | |
| 28 | Land | 1950 | 10 | \$ 630 | 300 | 1 | \$ 2 | \$ 118 | | | | |
| 29 | Access Road | 1963 | 1 | \$ 12,500 | 75 | 5 | \$ 167 | \$ 7,167 | | | | |
| 30 | Landscaping | 2000 | 1 | \$ 595 | 75 | 6 | \$ 8 | \$ 48 | | | | |
| 31 | Security fence | 1963 | 1 | \$ 1,360 | 75 | 7 | \$ 18 | \$ 780 | | | | |
| 32 | Sub Structure | | | | | | | | | | | |
| 33 | Cassion Outer | 1963 | 1 | \$ 30,600 | 75 | 6 | \$ 408 | \$ 17,544 | | | | |
| 34 | Upper Floor | 1963 | 1 | \$ 4,250 | 75 | 6 | \$ 57 | \$ 2,437 | | | | |
| 35 | Dry well | 1963 | 1 | \$ 6,800 | 75 | 6 | \$ 91 | \$ 3,899 | | | | |
| 36 | Landings and Stairs | 1963 | 9 | \$ 4,250 | 60 | 7 | \$ 71 | \$ 3,046 | | | | |
| 37 | Wet Well | 1963 | 1 | \$ 5,100 | 75 | 6 | \$ 68 | \$ 2,924 | | | | |
| 38 | Shaped floor | 1963 | 1 | \$ 850 | 75 | 6 | \$ 11 | \$ 487 | | | | |
| 39 | Sump pump | 1963 | 4 | \$ 595 | 40 | 6 | \$ 15 | \$ 640 | | | | |
| 40 | Pumps | | | | | | | | | | | |
| 41 | Drive shafts | 2006 | 6 | \$ 12,560 | 35 | 1 | \$ 359 | \$ - | | | | |
| 42 | Pumps | 2006 | 4 | \$ 29,750 | 40 | 1 | \$ 744 | \$ - | | | | |

Ready

start Modules 2 Duncan Rose - Inbox ... Webpage has expire...

EPA 0 Overview.ppt Day 1.EPA.Revised.ppt Microsoft Excel - EPA ...

10:43 AM Tuesday 4/10/2007